


PLAN

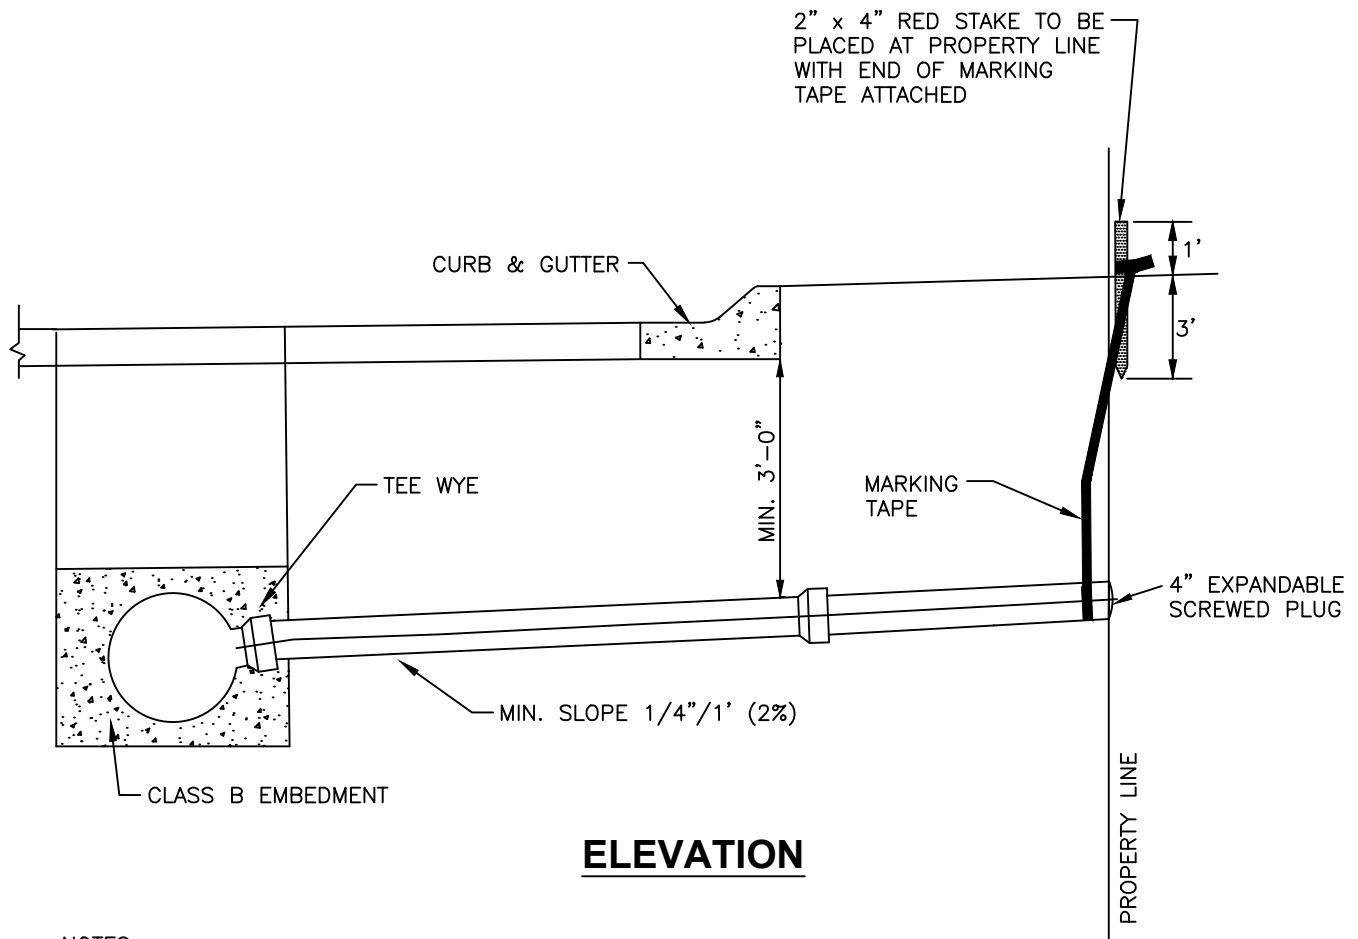

ELEVATION

NOTES:

- SERVICES WITH LESS THAN 2' CLEARANCE UNDER AN EXISTING OR PROPOSED STORM DRAIN REQUIRE CONCRETE ENCASEMENT OR STEEL CASING.
- SERVICES SHALL BE SDR-26 PVC PIPE WITH CLASS B EMBEDMENT.
- NEW SERVICE TAPS ON EXISTING MAINS REQUIRE INSERTA-TEE CONNECTION OR APPROVED EQUAL.
- SERVICES 8" AND LARGER REQUIRE A MANHOLE TO CONNECT TO MAIN. UNLESS OTHERWISE APPROVED BY WATER UTILITIES.



CITY OF ARLINGTON, TEXAS

SANITARY SEWER SERVICE

DATE: 01/06/2023