


5 FOOT SIDEWALK WITH WALL
 NTS REV: 8/8/17

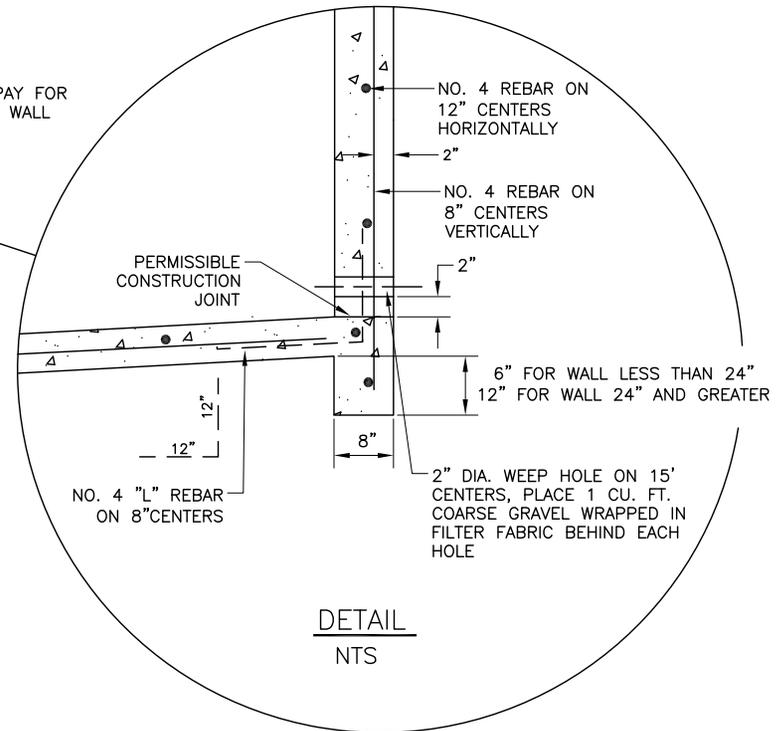

DETAIL
 NTS

NOTES:

1. IN LOCATIONS WHERE WALL HEIGHT DOES NOT EXCEED 1', WEEP HOLES CAN BE OMITTED.
2. REDWOOD JOINTS IN WALL SHALL MATCH REDWOOD JOINTS IN THE SIDEWALK. THE WALL SHALL BE DOUBLE CHAMFERED AT THE REDWOOD LOCATIONS.
3. ENDS OF WALL SHALL ALSO BE CHAMFERED.
4. CONCRETE SHALL BE CLASS C, 5 1/2 SACK AND HAVE COMPRESSIVE STRENGTH OF 3600 PSI AT 28 DAYS.
5. EXPOSED FACE OF WALL SHALL HAVE FORM LINER FINISH UNLESS OTHERWISE DIRECTED BY THE CITY. (*SEE FORM LINER DETAIL)
6. FILTER FABRIC MATERIALS AND CONSTRUCTION METHODS SHALL CONFORM TO CITY OF ARLINGTON STANDARDS AND SPECIFICATIONS.



CITY OF ARLINGTON, TEXAS

5 FOOT SIDEWALK WITH WALL

DATE:	SCALE: NTS	SHEET: ____ OF ____
DESIGNED BY:	DRAWN BY:	CHECKED BY: