


6'-0"  
LIMITS OF PAY FOR SIDEWALK

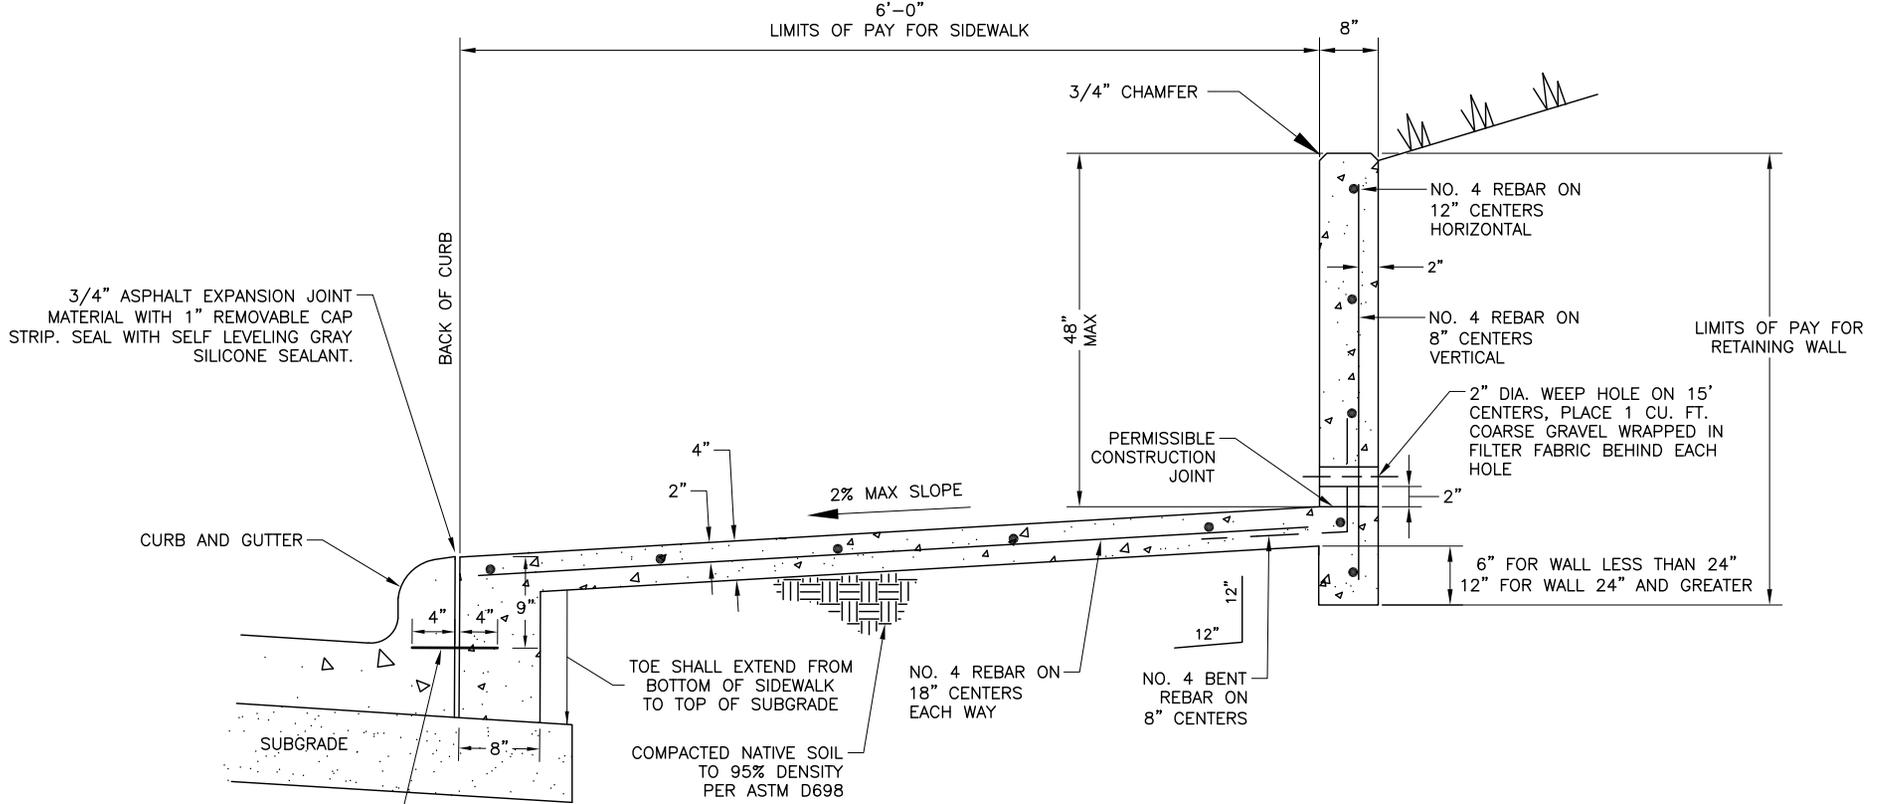

3/4" ASPHALT EXPANSION JOINT MATERIAL WITH 1" REMOVABLE CAP STRIP. SEAL WITH SELF LEVELING GRAY SILICONE SEALANT.

BACK OF CURB

CURB AND GUTTER

SUBGRADE

TOE SHALL EXTEND FROM BOTTOM OF SIDEWALK TO TOP OF SUBGRADE

COMPACTED NATIVE SOIL TO 95% DENSITY PER ASTM D698

NO. 4 REBAR ON 18" CENTERS EACH WAY

NO. 4 BENT REBAR ON 8" CENTERS

3/4" CHAMFER

48" MAX

PERMISSIBLE CONSTRUCTION JOINT

NO. 4 REBAR ON 12" CENTERS HORIZONTAL

NO. 4 REBAR ON 8" CENTERS VERTICAL

2" DIA. WEEP HOLE ON 15' CENTERS, PLACE 1 CU. FT. COARSE GRAVEL WRAPPED IN FILTER FABRIC BEHIND EACH HOLE

LIMITS OF PAY FOR RETAINING WALL

6" FOR WALL LESS THAN 24"  
12" FOR WALL 24" AND GREATER

DRILL AND EPOXY 8" LONG NO. 4 REBAR ON 24" CENTERS.

NOTES:

1. IN LOCATIONS WHERE WALL HEIGHT DOES NOT EXCEED 1', WEEP HOLES CAN BE OMITTED.
2. REDWOOD JOINTS IN WALL SHALL MATCH REDWOOD JOINTS IN THE SIDEWALK. THE WALL SHALL BE DOUBLE CHAMFERED AT THE REDWOOD LOCATIONS.
3. ENDS OF WALL SHALL ALSO BE CHAMFERED.
4. CONCRETE SHALL BE CLASS C, 5 1/2 SACK AND HAVE COMPRESSIVE STRENGTH OF 3600 PSI AT 28 DAYS.
5. EXPOSED FACE OF WALL SHALL HAVE FORM LINER FINISH UNLESS OTHERWISE DIRECTED BY THE CITY. (\*SEE FORM LINER DETAIL)
6. FILTER FABRIC MATERIALS AND CONSTRUCTION METHODS SHALL CONFORM TO CITY OF ARLINGTON STANDARDS AND SPECIFICATIONS.

6 FOOT SIDEWALK WITH WALL  
NTS REV: 8/8/17

 CITY OF ARLINGTON, TEXAS		
<b>6 FOOT SIDEWALK WITH WALL</b>		
DATE:	SCALE: NTS	SHEET ____ OF ____
DESIGNED BY:	DRAWN BY:	CHECKED BY: