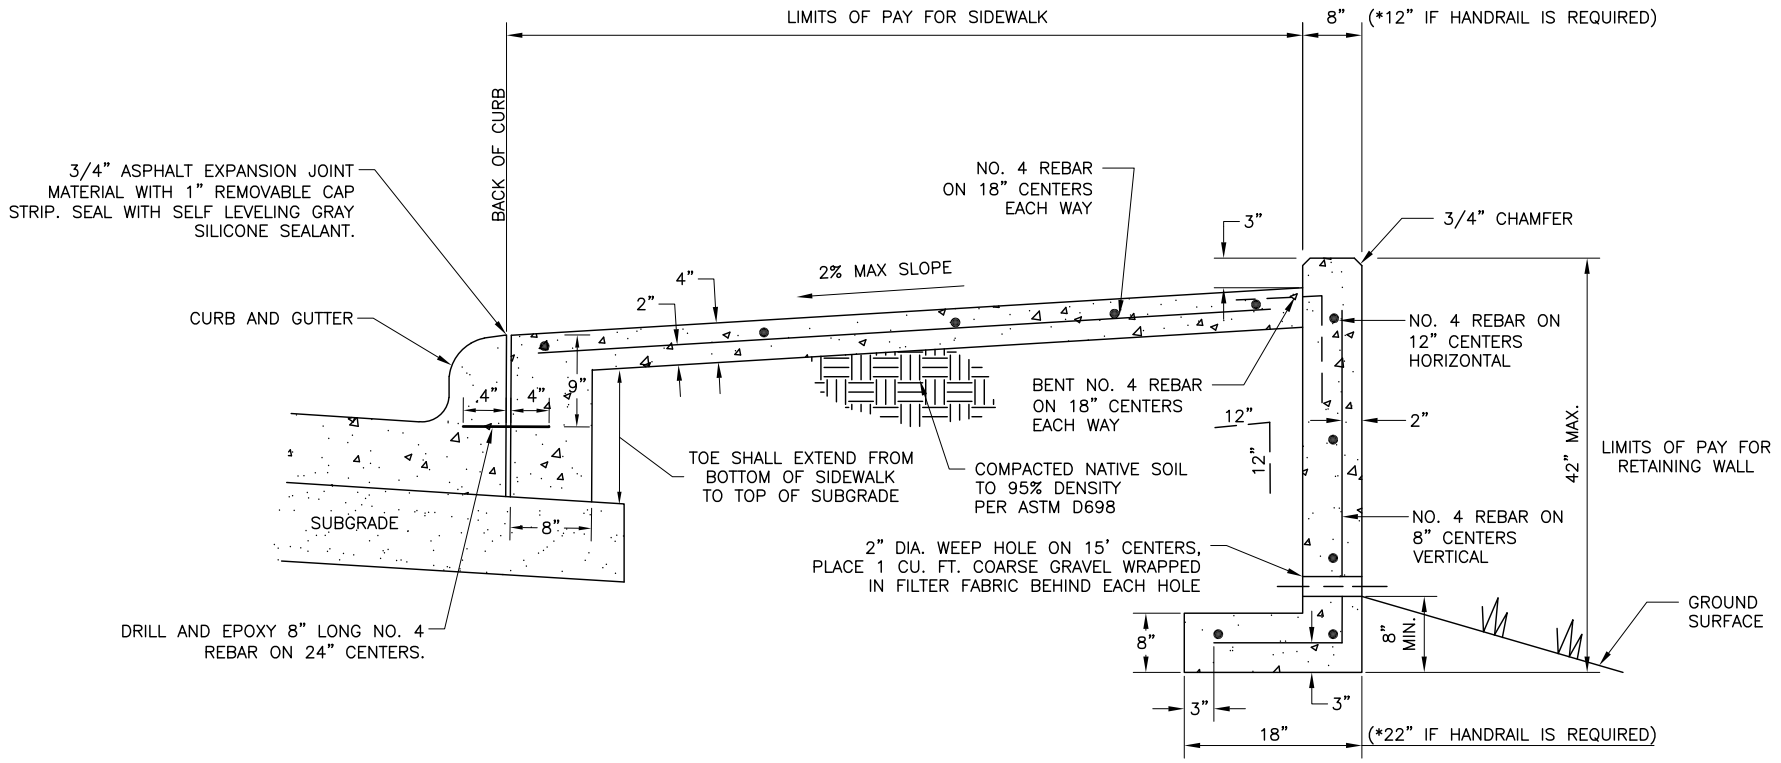

SIDEWALK WITH LOW WALL

NTS REV: 8/15/17

NOTES:

1. REDWOOD JOINTS IN WALL SHALL MATCH REDWOOD JOINTS IN THE SIDEWALK. THE WALL SHALL BE DOUBLE CHAMFERED AT THE REDWOOD LOCATIONS.
2. ENDS OF WALL SHALL ALSO BE CHAMFERED.
3. CONCRETE SHALL BE CLASS C, 5 1/2 SACK AND HAVE COMPRESSIVE STRENGTH OF 3600 PSI AT 28 DAYS.
4. EXPOSED FACE OF WALL SHALL HAVE FORMLINER FINISH UNLESS OTHERWISE DIRECTED BY THE CITY. (*SEE FORM LINER DETAIL)
5. FILTER FABRIC MATERIALS AND CONSTRUCTION METHODS SHALL CONFORM TO CITY OF ARLINGTON STANDARDS AND SPECIFICATIONS.

CITY OF ARLINGTON, TEXAS		
SIDEWALK WITH LOW WALL		
DATE:	SCALE: NTS	SHEET_____OF_____
DESIGNED BY:	DRAWN BY:	CHECKED BY: