



(ALL CONCRETE SHOWN, INCLUDING CURB, IS MEASURED AS VALLEY GUTTER QUANTITY)

**VALLEY GUTTER AT INTERSECTION**  
NTS

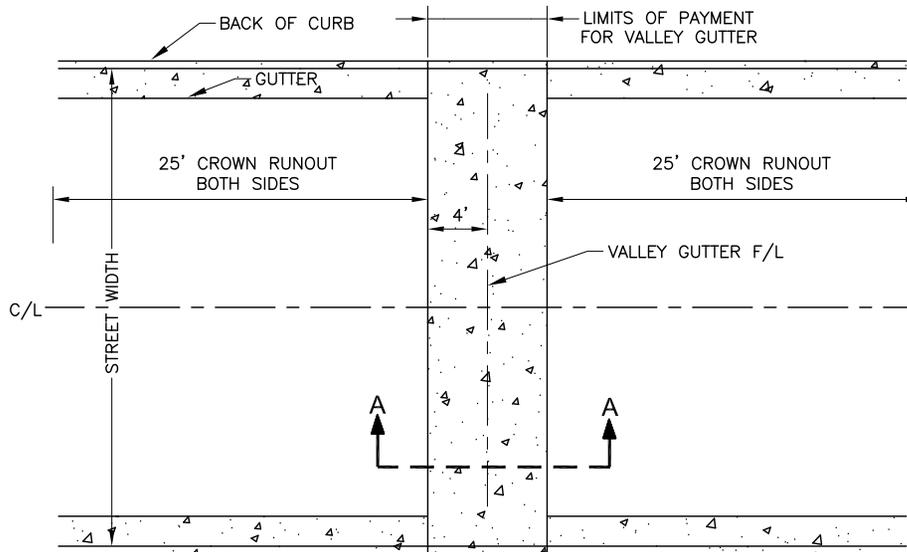

**VALLEY GUTTER AT MID-BLOCK**  
NTS  
REV: 7/25/17

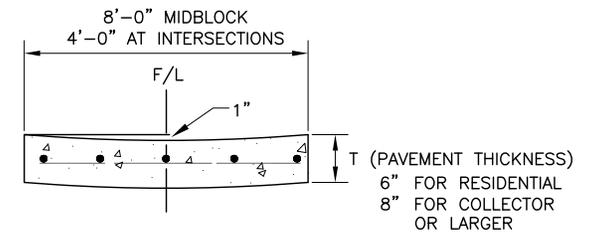

**SECTION A-A**  
NTS

**NOTES:**

1. ALL CONCRETE FOR VALLEY GUTTER SHALL BE CLASS C, 5 1/2 SACK, 3600 PSI.
2. REINFORCING STEEL SHALL BE NO. 4 REBAR ON 12 INCH CENTERS BOTH WAYS.
3. CURB WILL BE SUBSIDIARY TO PAYMENT OF VALLEY GUTTER
4. VALLEY GUTTER SHALL BE PLACED ON 8 INCH CEMENT TREATED BASE (CTB). CTB IS SUBSIDIARY TO VALLEY GUTTER UNIT PRICE.



**CITY OF ARLINGTON, TEXAS**

**VALLEY GUTTER**

DATE:	SCALE: NTS	SHEET ___ OF ___
DESIGNED BY:	DRAWN BY:	CHECKED BY: